


# GRAPHICAL DISPLAY

The graphical display shows condition you have to met next or alternatively if you are allowed to enter or have to exit the building. On the top line there are icons of all conditions and the counter of people. Colored conditions have to be met to enter, gray conditions doesn't have to be met or can't be met yet. On the rest of the screen, there is a big icon of a condition which should be met next and next to the icon is text in three lines. On the first line there's a caption, on the other two lines is a text associated with a required condition that is shown with a big icon. Caption and text can be changed in the Display settings menu in the right column:

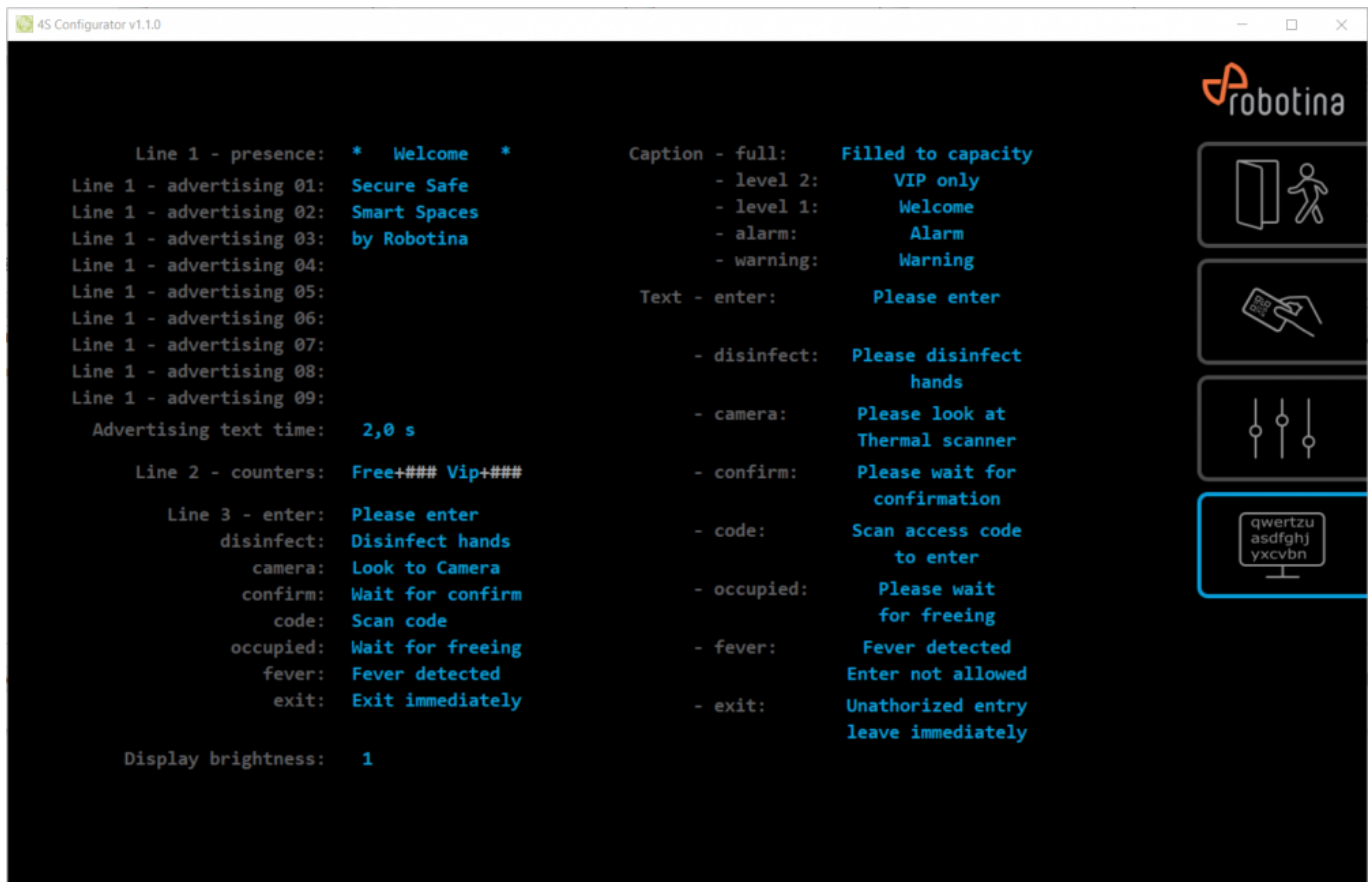

For pictures with examples, we will take the configuration of a picture above as an example.

## CAPTIONS AND TEXT

In the upper left corner the counter is shown. Upper counter is for the number of the people with L1 access that can still enter the building, bottom counter is for the number of the people with L2 access that can still enter. When everyone can still enter the building, the caption can be set under "Caption - level 1: ". In the next picture it's set on "Caption - level 1: Welcome".



When L1 capacity is full, but L2 can still enter the caption can be set under "Caption - level 2: ". In the next picture it's set on "Caption - level 2: VIP only".



When L2 capacity is also full and only UL access can enter the caption can be set under "Caption - full: " and the text can be set under "Text - occupied: ". In the next picture, caption is set on "Caption - full: Filled to capacity" and the text is set on "Text - occupied: "Please wait" on the first line and "for freeing" on the second.



If the alarm is triggered, the caption can be set under "Caption - alarm: " and the text can be set under "Text - exit: ". In the next picture, caption is set on "Caption - alarm: Alarm" and the text is set on "Text - exit: "Unauthorized entry", "leave immediately".



If the fever is detected the caption can be set under "Caption - warning: " and the text can be set under "Text - fever: ". In the next picture the caption is set on "Caption - warning: Warning" and the text is set on "Fever detected", "Enter not allowed".



If the required condition is to disinfect hands, the text can be set under Text - disinfect: "Please disinfect", "hands".



Next icon is shown if the person has to close his face to the thermal scanner. The text is set under Text - camera: "Please look at", "Thermal scanner".



Next icon is shown if the access code has to be scanned. The text is set under Text - code: "Scan access code", "to enter".



Next icon is shown if the receptionist's confirmation is required to enter. The text is set under Text - confirm: "Please wait for", "confirmation".



Next icon is shown it the person is allowed to enter. The text is set under Text - enter: "Please enter".



From:

<http://wiki.hiq-home.com/> -

Permanent link:

[http://wiki.hiq-home.com/doku.php?id=en:3s:tv\\_display&rev=1592894896](http://wiki.hiq-home.com/doku.php?id=en:3s:tv_display&rev=1592894896)

Last update: **2020/06/23 06:48**

