Typical installations

Small shop, pharmacy

Requirements

- limited number of visitors
- one passage for access and exit
- automatic door
- required temperature measurement
- required disinfection

Installation

- SGate is installed at the entrance from the outside of the automatic door.
- Entry detection sensors are mounted on one of the sides or on an additional carrier depending on the physical layout of the SGate relative to the door..
- The automatic door opening signal is connected to the SGate and in parallel to the internal automatic opening sensor.
- The staff has a wireless button to confirm alarms or to open the door manually in case of exceptions.

Settings

Department store


Requirements

- limited number of visitors
- one-way entrance with swing gate
- separate exit
- required temperature measurement
- required disinfection
- staff can access it by scanning the code even when the count limit 1 is exceeded
- staff do not need to scan the temperature 4 hours after a successful scan
- hand disinfection is not mandatory for employees


Installation

- SGate is installed at the entrance from the outside of the swing gate.
- Entry detection sensor is mounted on side of SGate or on an additional carrier depending on the physical layout of the SGate relative to the gate.
- Security guard has a wireless button to confirm alarms or to open the door manually in case of exceptions.

Settings

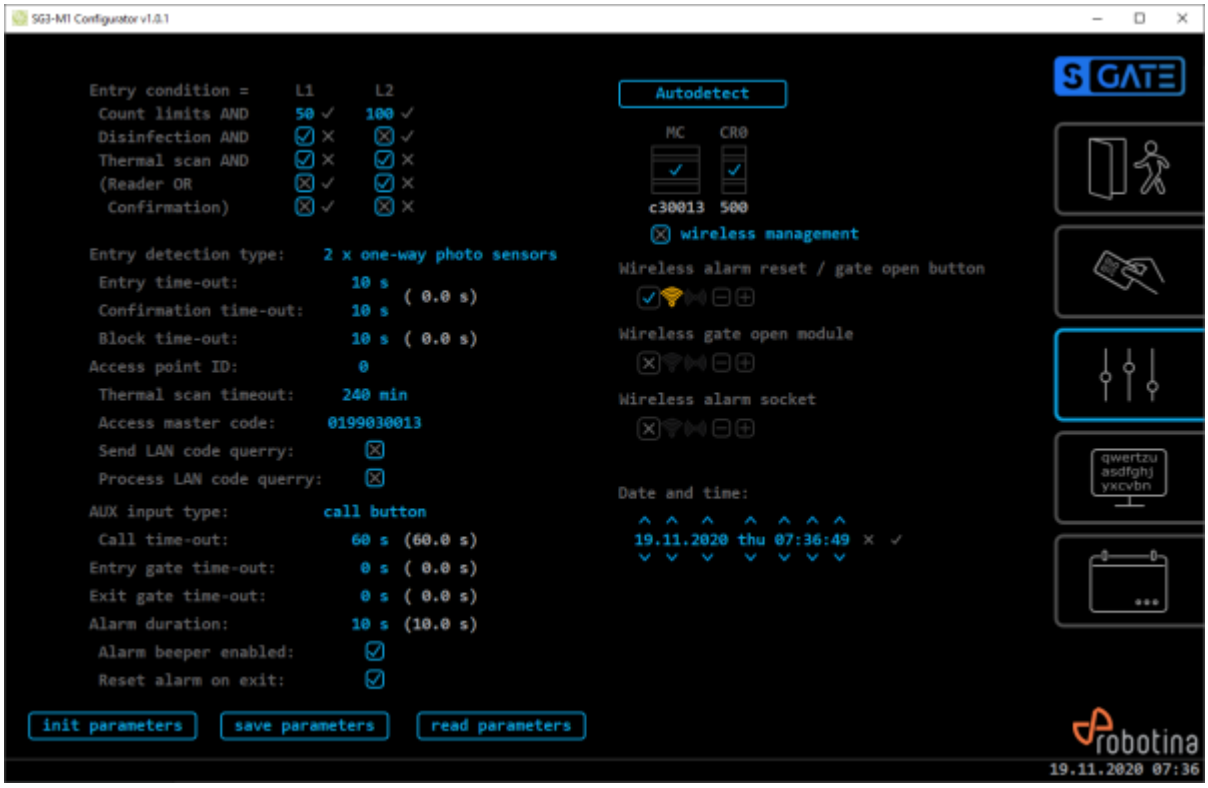

Staff code

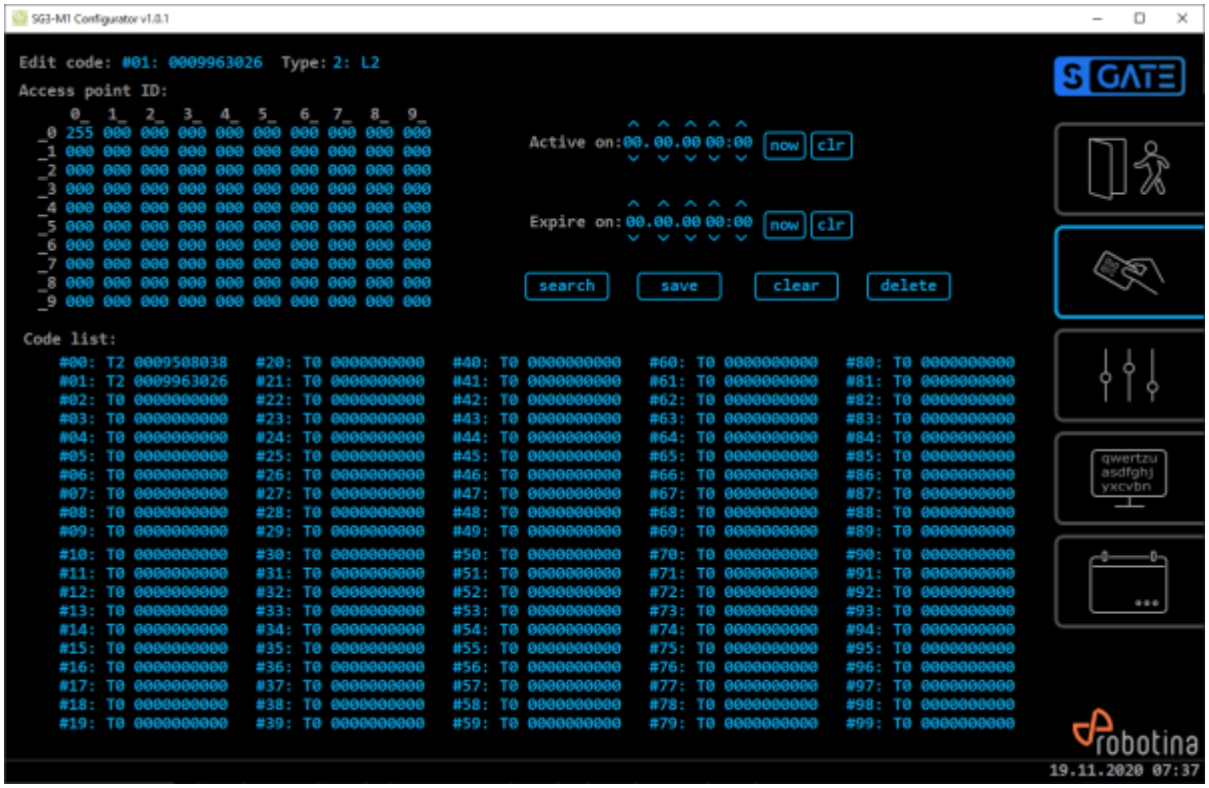


Offices

Requirements


- number of visitors not limited
- one passage for access and exit
- automatic door
- required temperature measurement
- employees do not need to scan the temperature 4 hours after a successful scan
- required disinfection
- required authentication with code for employees and guests
- guests are exceptionally allowed to enter with confirmation of the reception (without code)

Installation


- SGate is installed at the entrance from the outside of the automatic door.
- Entry detection sensor is mounted on side of SGate or on an additional carrier depending on the physical layout of the SGate relative to the door.
- Receptionist has a wireless button or PC application to confirm alarms or to open the door manually in case of exceptions.
- Upon booking a meeting, each guest receives a QR code, which is time limited.

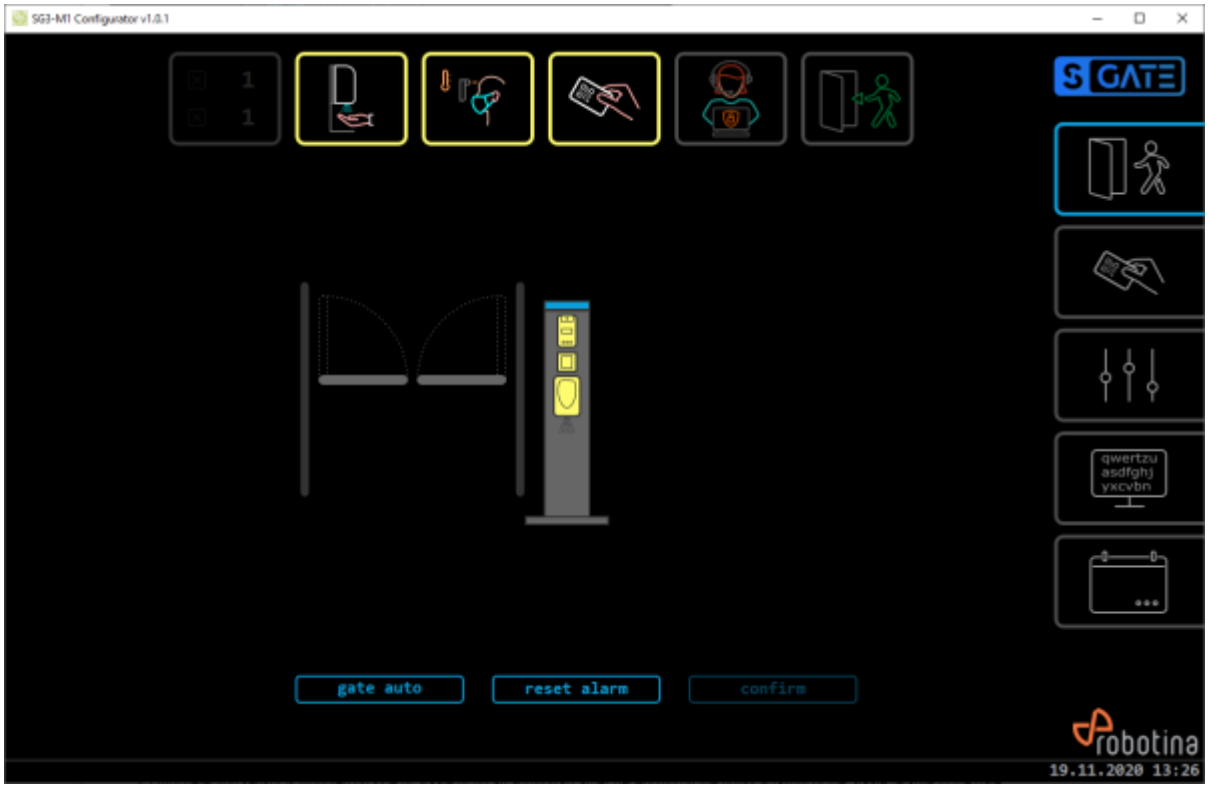


Settings

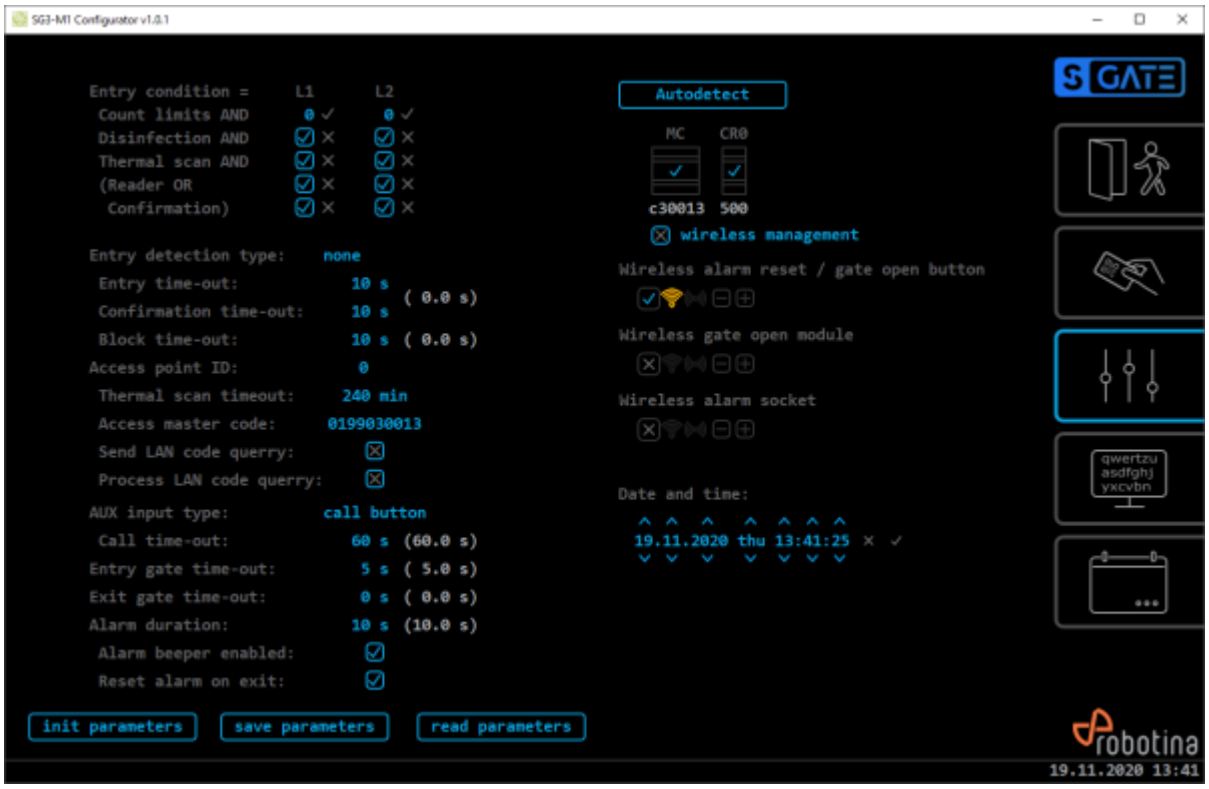

Employee code

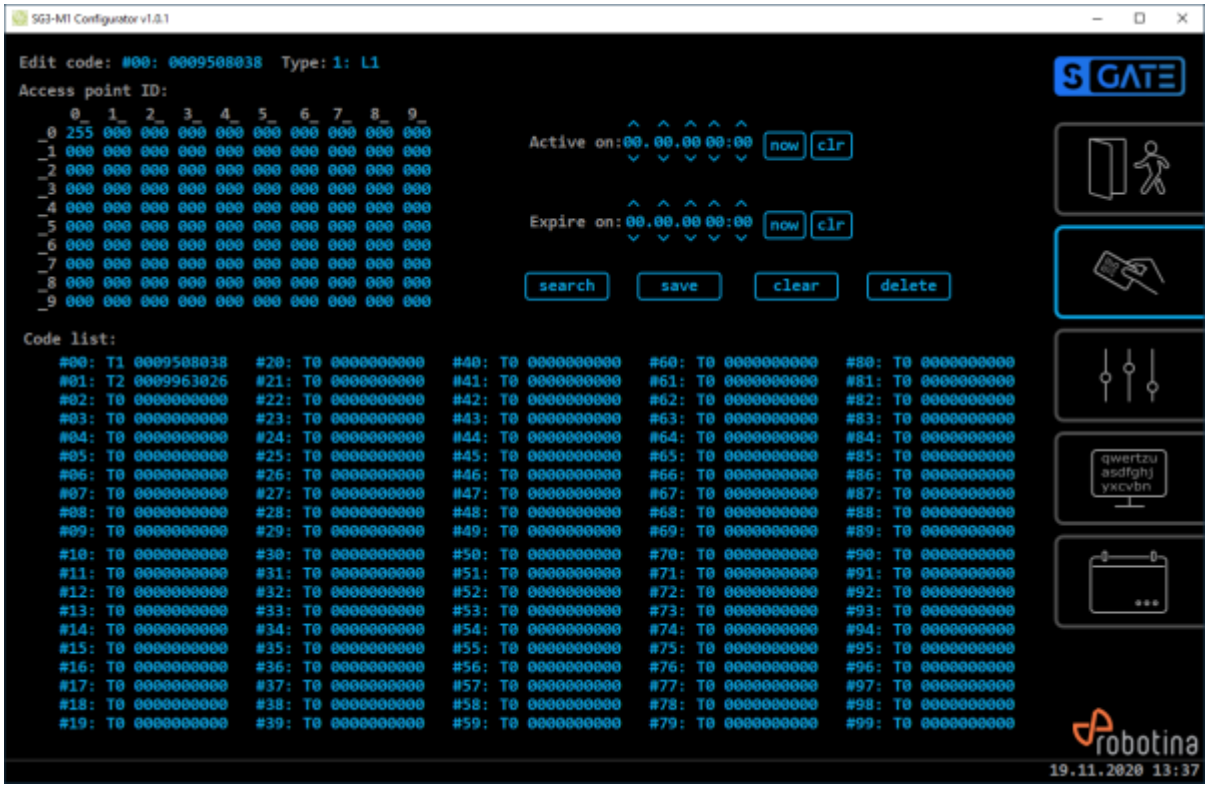

Guest code

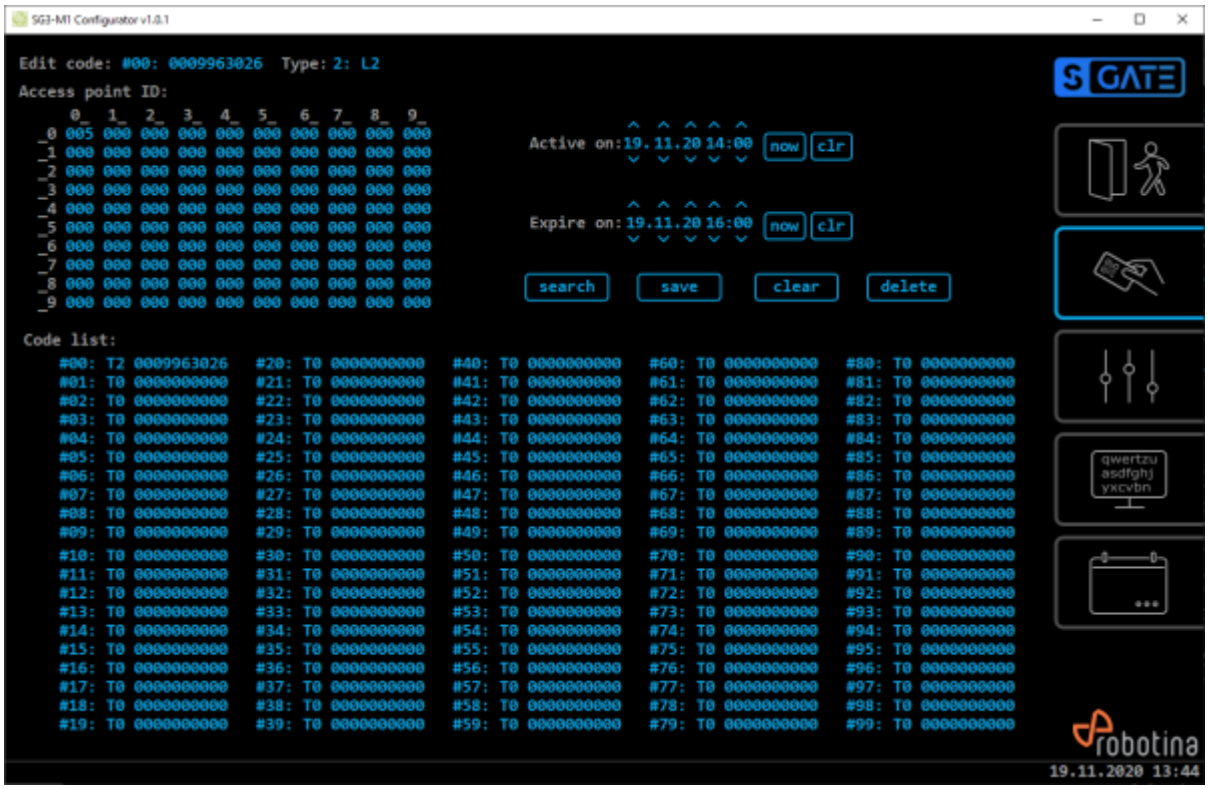


Health Center

Requirements


- visitors can enter only at a specified time
- one passage for access and exit
- automatic door
- required temperature measurement
- required disinfection

Installation


- SGate is installed at the entrance from the outside of the automatic door.
- Entry detection sensors are mounted on side of SGate or on an additional carrier depending on the physical layout of the SGate relative to the door.
- Receptionist has a wireless button to confirm alarms or to open the door manually in case of exceptions.
- Upon booking, each visitor receives a QR code, which is time limited.

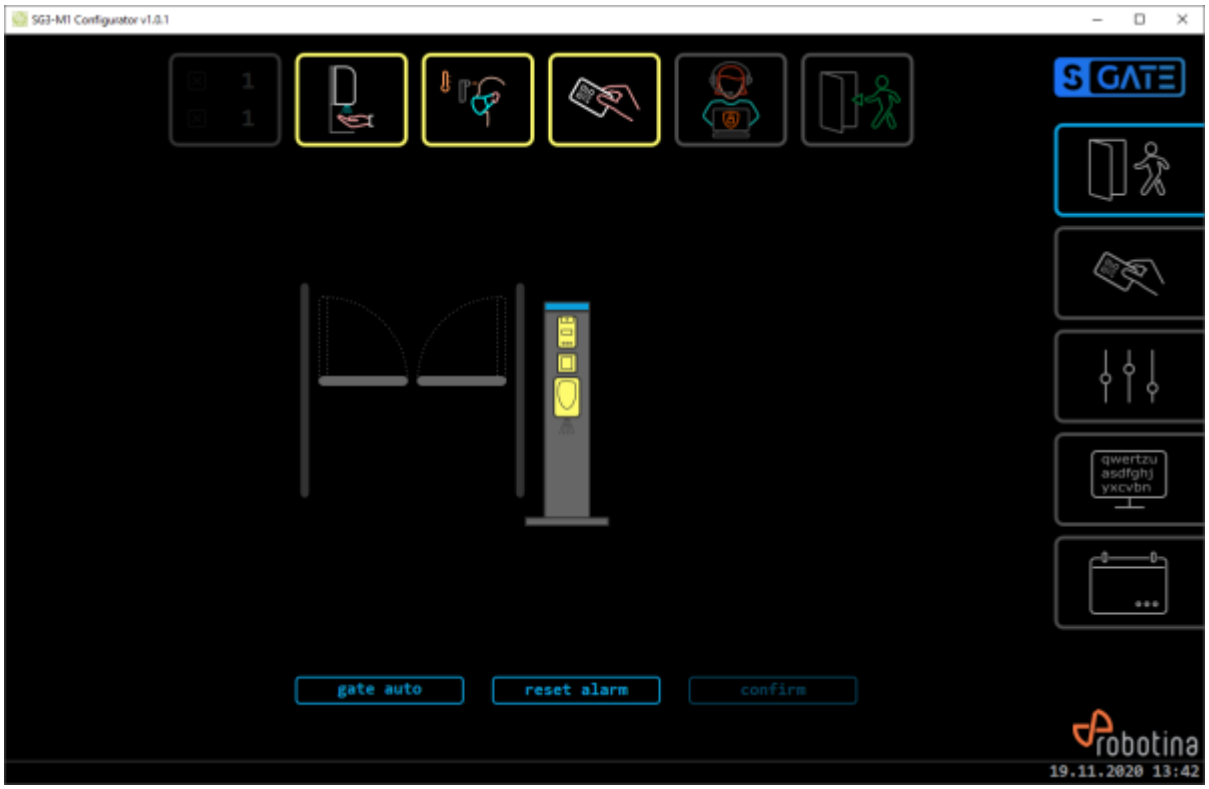

Settings

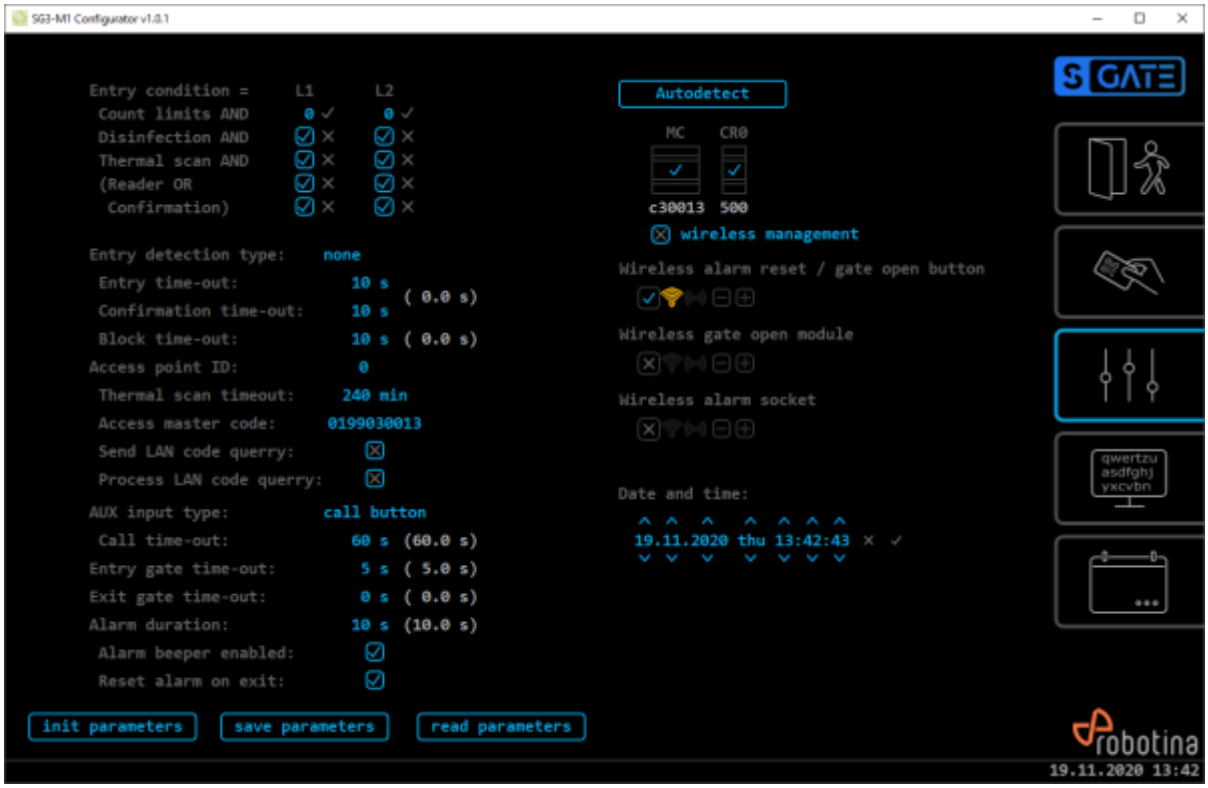
SG3-MT Configurator v1.0.1
Entry condition = L1 L2
Count limits AND 0 0
Disinfection AND
Thermal scan AND
(Reader OR
Confirmation)
Entry detection type: none
Entry time-out: 10 s
Confirmation time-out: 10 s (0.0 s)
Block time-out: 10 s (0.0 s)
Access point ID: 0
Thermal scan timeout: 240 min
Access master code: 0199030013
Send LAN code querry:
Process LAN code querry:
AUX input type: call button
Call time-out: 60 s (60.0 s)
Entry gate time-out: 5 s (5.0 s)
Exit gate time-out: 0 s (0.0 s)
Alarm duration: 10 s (10.0 s)
Alarm beeper enabled:
Reset alarm on exit:
init parameters
save parameters
read parameters
Autodetect
MC CR0
c30013 500
wireless management
Wireless alarm reset / gate open button
Wireless gate open module
Wireless alarm socket
Date and time:
19.11.2020 thu 13:42:43
SGATE
qwertzu
asdfghj
yxcvbn
robotina
19.11.2020 13:42

Guest code

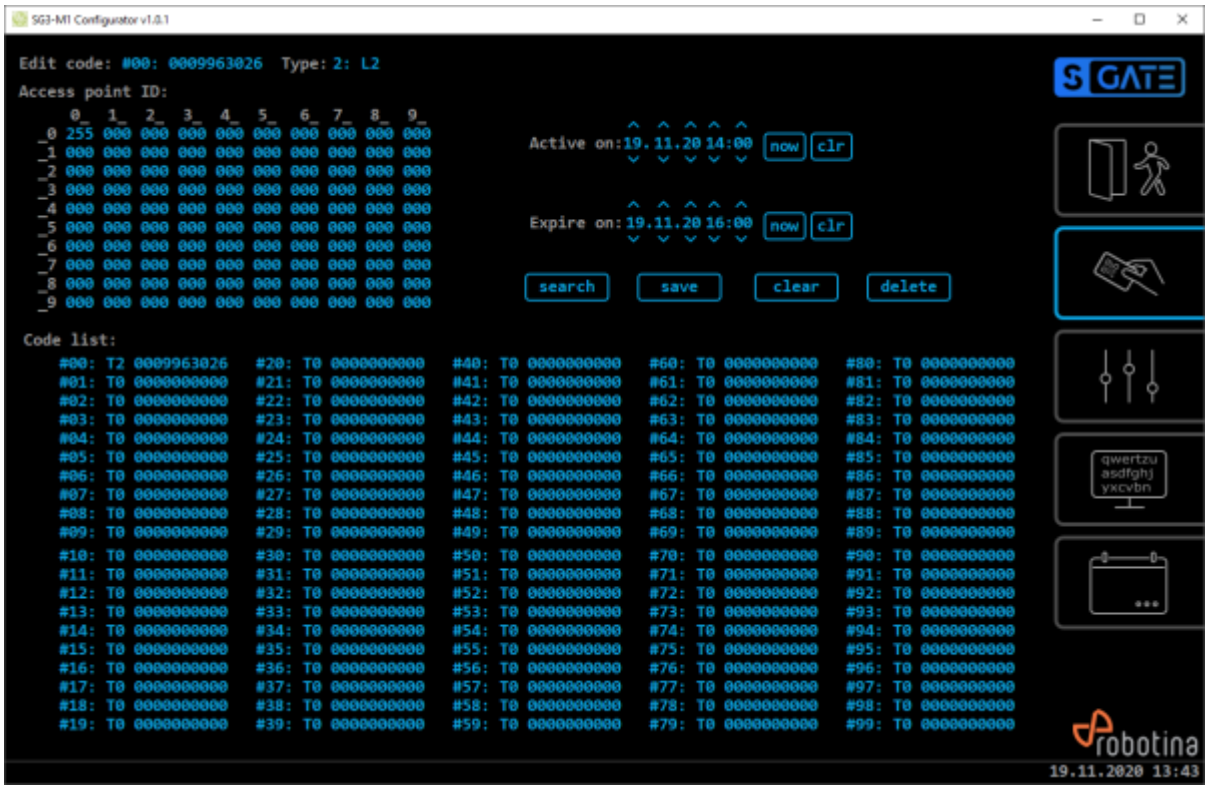
SG3-MT Configurator v1.0.1
Edit code: #00: 0009963026 Type: 2: L2
Access point ID:
Active on: 19.11.20 14:00 now clr
Expire on: 19.11.20 16:00 now clr
search
save
clear
delete
Code list:
SGATE
qwertzu
asdfghj
yxcvbn
robotina
19.11.2020 13:43

From:
https://wiki.hiq-home.com/ -

Permanent link:
https://wiki.hiq-home.com/doku.php?id=en:sg3:installations&rev=1606474948

Last update: **2020/11/27 11:02**